

TEST REPORT

Lucideon Reference: 164962 (QT39584/2/JPS)/Ref. 5

Project Title: Testing of Balustrade System TL-3031 in Accordance with BS 6180:2011

Barriers In and About Buildings

Client: OnLevel Gmbh

Groendahlscher Weg 87

46446 Emmerich

Germany

For the Attention of: Mr Frank Verhey

Author(s): Miss Lisa Cobden

Report Date: 16 March, 2017

Purchase Order No.: 71160562 FV

Work Location: Lucideon UK

Miss Joanne Booth **Consultancy Team**

pame food

Reviewer

Miss Lisa Cobden Consultancy Team Project Manager

bu Col-





CONTENTS

		Page
1	INTRODUCTION	3
2	TEST SAMPLES	3
3	TEST PROGRAMME	3
4	TEST METHOD	3
5	RESULTS	4
TA	BLES	5-6
PL	ATE	7
CHART		8
AF	PPENDIX - Figures	

1 INTRODUCTION

Lucideon were commissioned by the client, OnLevel Gmbh, to carry out load testing in accordance with BS 6180:2011 Barriers in and about buildings, to allow their balustrade system to be classified for use in accordance with BS 6180:2011 Barriers in and about buildings – Code of Practice.

The testing was carried out at OnLevel's facilities at Innovatielaan 25 8447 SN Heerenveen The Netherlands.

This report summarises the test results obtained during the test programme and does not provide interpretation of those results.

2 TEST SAMPLES

The aluminium channel tested was designated as System TL-3031. The system is shown in Figure 1.

The channel was installed by OnLevel personnel.

3 TEST PROGRAMME

A horizontal line load was carried out on the aluminium channel with the following glass types installed:

- Laminated Tempered Glass with PVB Foil 15 15 4 size (w x h): 1000 mm x 1250 mm.
- Laminated Tempered Glass with PVB Foil 12 12 4 size (w x h): 1000 mm x 1200 mm.
- Laminated Tempered Glass with PVB Foil 10 10 4 size (w x h): 1000 mm x 1250 mm.

4 TEST METHOD

The channel was bolted to the side of a concrete block, nominally 0.5 m x 0.5 m x 3.5 m which was fixed to the floor of the test facility. The 1.0 m channel was bolted to the block at 250 mm centres by the client using the appropriate fixings (see Figure 1 and Figure 2).

The appropriate thickness glass panel was fitted into the channel using three 'Flex Fit' fixing clips at nominally 312.5 mm centres. The clips were placed such that the plastic clip was to the outside face of the glass (see Figure 3 and 4).

A horizontal imposed line load was applied to the 12/12/4 glass at a height of 1105 mm above the datum level of the floor and at 1155 mm for the 15/15/4 and 10/10/4 glass. The deflection was measured at the top central point of the panel 1100 mm above the datum level of the floor for the 12/12/4 glass and at 1155 mm for the 15/15/4 and 10/10/4 glass. The load was applied via a hydraulic ram and the deflection measured using a digital electronic displacement transducer (Plate 1).





5 RESULTS

The test was carried out in accordance with the guidance given in BS 6180 Barriers in and about buildings — Code of Practice. The standard states that the maximum allowable deflection for a free standing glass protective barrier panel is 25 mm.

Table 2 of BS 6180 Barriers in and about buildings – Code of Practice categorises parapets, barriers and balustrades for areas of use depending on the loads they have achieved under testing.

The loads achieved by the OnLevel glazing system tested under horizontal imposed line load to the maximum deflection of 25 mm are given in Table 1.

All figures quoted in Table 1 contain no safety factors and are direct loads as achieved by the system under test conditions.

Table 2 summarises the suitability of the tested systems in accordance with Table 2 of BS 6180:2011.

NOTE: The results given in this report apply only to the samples that have been tested.

END OF REPORT





Table 1 - Summary of Performance of OnLevel Balustrade System Tested under Horizontal Imposed Line Load

Base Rail	Glass	Height of Applied Load mm	Imposed Line Load at 25 mm Deflection (kN/m)	Working Line Load for System (kN/m)	Deflection at Working Line Load for System (mm)
O. rata ra	15/15/4	1155	2.14	1.50	14.34
System TL-3031	12/12/4	1105	1.66	1.50	21.50
112-3031	10/10/4	1155	1.50	1.50	22.13



Test Report: 164962/Ref. 5

Table 2 - Summary of Suitability of OnLevel Balustrade Systems in Accordance with Table 2 of BS 6180:2011

Type of Occupancy for	F	Horizontal Uniformly	TL-3031		
Part of the Building	Examples of Specific Use	Distributed Line Load (kN/m)	15/15/4 1155 mm	12/12/4 1100 mm	10/10/4 1155 mm
Domestic and residential	(i) all areas within or serving exclusively one single family dwelling including stairs, landings, etc. but excluding external balconies and edges of roofs	0.36	√	√	√
activities	(ii) other residential, i.e. houses of multiple occupancy and balconies, including Juliette balconies and edges of roofs in single family dwellings	0.74	✓	✓	√
Offices and work	(iii) light access stairs and gangways not more than 600 mm wide	0.22	✓	✓	✓
areas not included	(iv) light pedestrian traffic routes in industrial and storage buildings except designated escape routes	0.36	✓	✓	✓
elsewhere, including storage areas	(v) areas not susceptible to overcrowding in office and institutional buildings, also industrial and storage buildings except as given above	0.74	√	√	✓
Areas where people might congregate	(vi) areas having fixed seating within 530 mm of the barrier, balustrade or parapet	1.50	✓	√	✓
Areas with tables or fixed seating	(vii) restaurants and bars	1.50	✓	✓	✓
Areas without	(viii) stairs, landings corridors ramps	0.74	✓	✓	✓
obstacles for moving people and not susceptible to overcrowding	(ix) external balconies including Juliette balconies and edges of roofs; footways and pavements within building cartilage adjacent to basement/sunken areas	0.74	✓	√	✓
	(x) footways or pavements less than 3 m wide adjacent to sunken areas	1.50	✓	✓	✓
Areas susceptible to overcrowding	(xi) theatres, cinemas, discotheques, bars, auditoria, shopping malls, assembly areas, studios; footways or pavements greater than 3 m wide adjacent to sunken areas	3.00	×	×	x
	(xii) grandstands and stadia	(Note 1)	-	-	-
Retail areas	(xiii) all retail areas including public areas of banks/building societies or betting shops	1.50	✓	√	✓
Vehicular	(xiv) pedestrian areas in car parks, including stairs, landings, ramps, edges of internal floors, footways, edges of roofs	1.50 (Note 2)	√	√	√
	(xv) horizontal loads imposed by vehicles	(Note 2)	-	-	-

Note 1 – See requirements of the appropriate certifying authority

Note 2 – Clause 8.1.1 of BS 6180:2011 states that "glass should not be used for vehicle protection barriers"

Test Report: 164962/Ref. 5





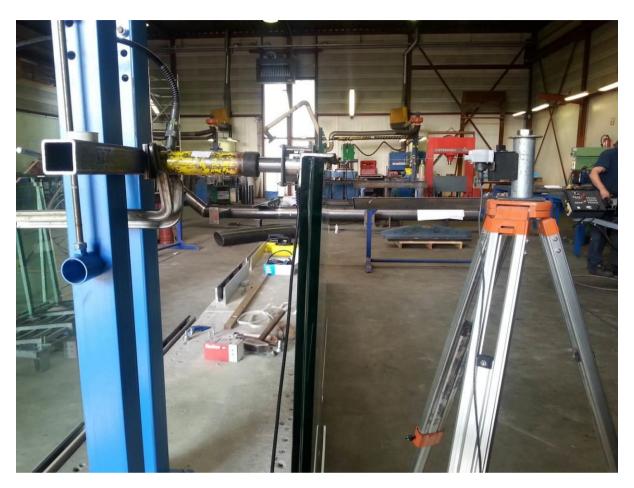



Plate 1 - Generic Test Arrangement

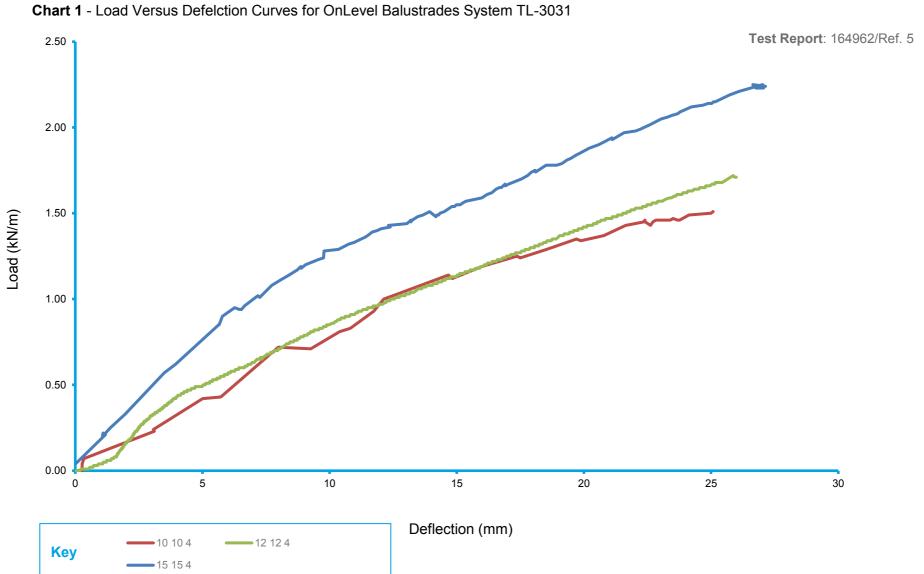

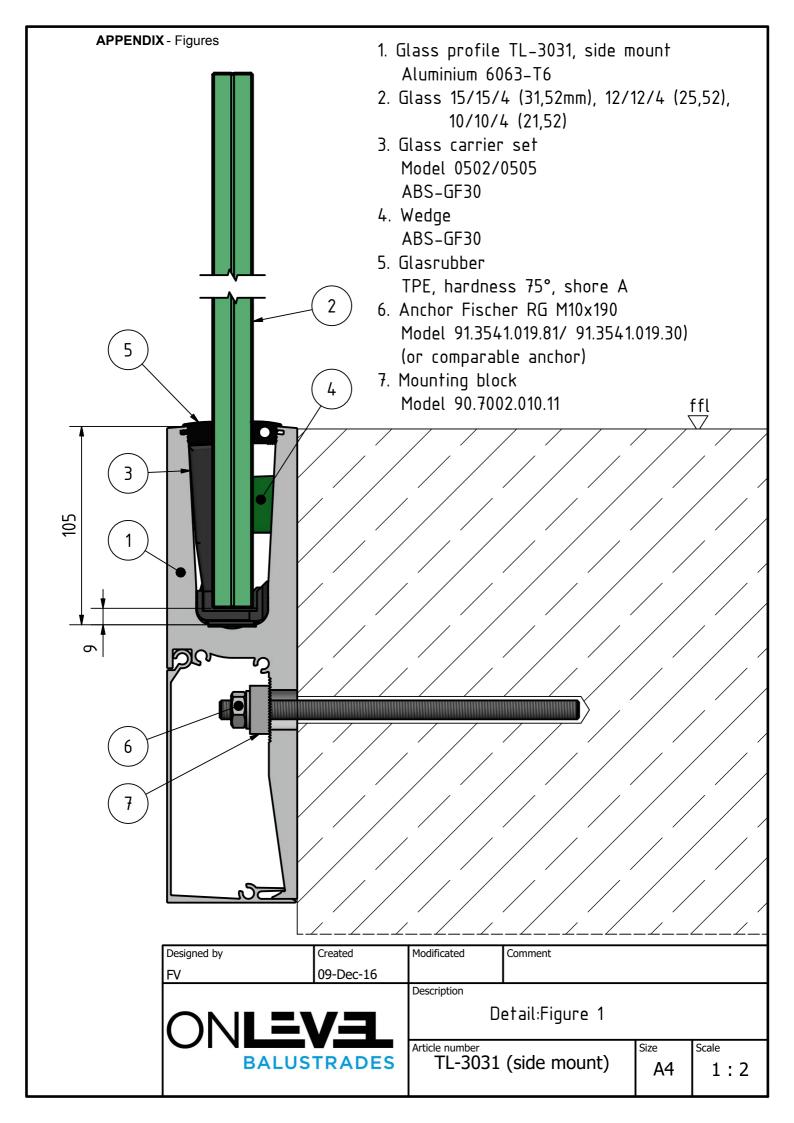

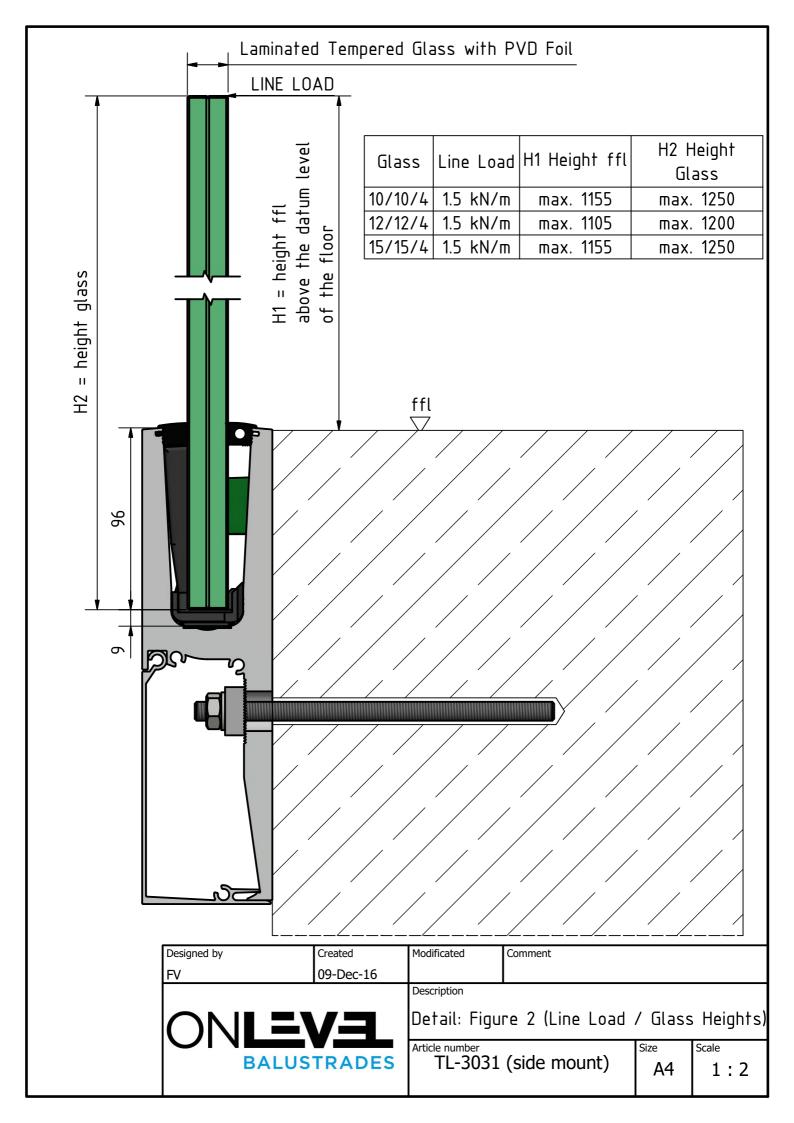


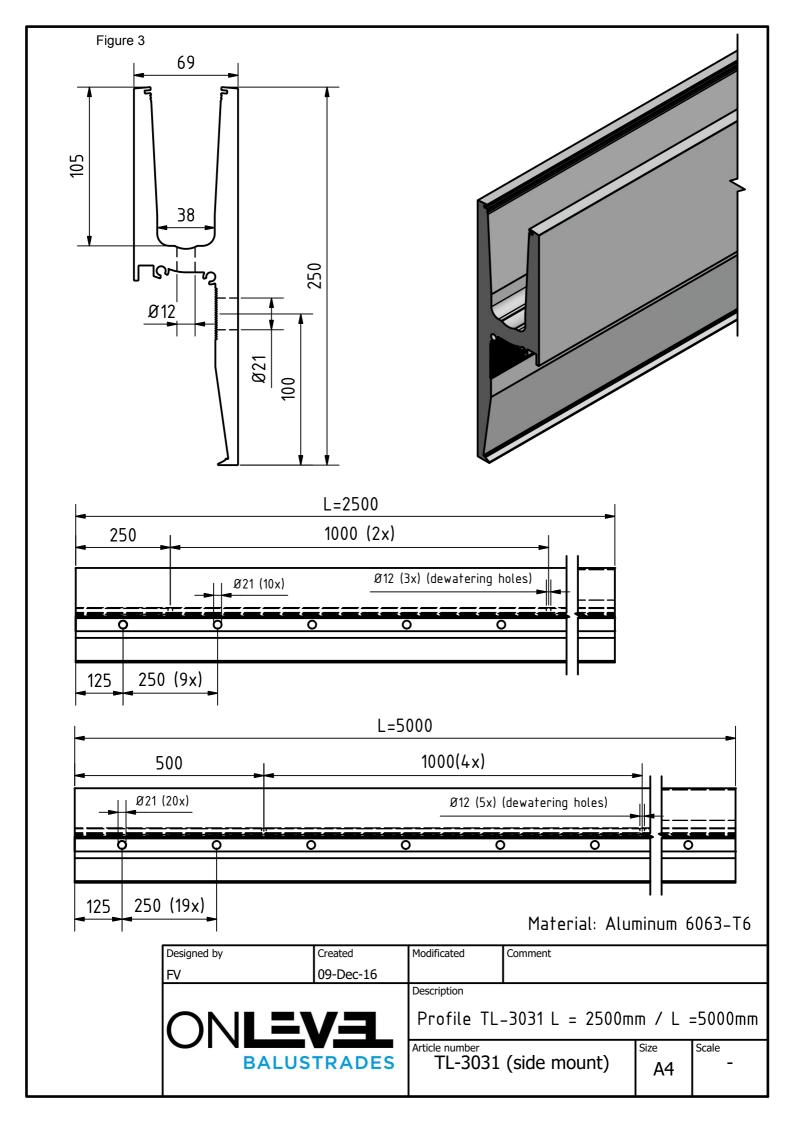

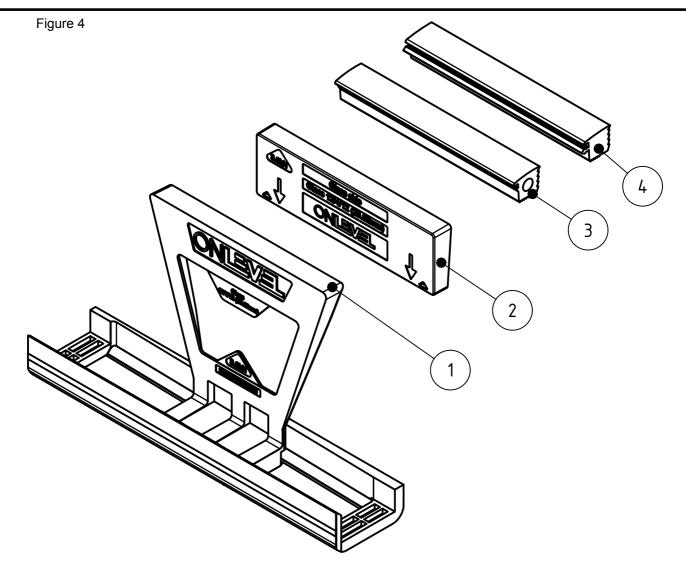

ITEM	PCS (L=2500mm)	PCS (L = 5000mm)	Description		
1	8	16	Flex-Fit 3.0KN		
2	8	16	Glass Wedge 3.0kN		
3	1 (L=2500mm)	1 (L=5000mm)	Rubber User Side		
4	1 (L=2500mm)	1 (L=5000mm)	Rubber Falling Side		

Distance Glass Carrier / Glass Wedges :

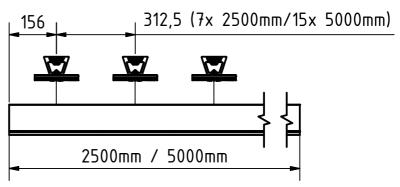

Designed by	Created	Modificated	Comment		
FV	09-Dec-16				
į.		Description			
ONLEVE BALUSTRADES		Flex-Fits sets (quantity and distance)			
		Article number TL-3031	(side mount)	Size A4	Scale -